



ISTITUTO  
GIORDANO



Istituto Giordano S.p.A.  
Via Rossini, 2 - 47814 Bellaria-Igea Marina (RN) - Italy  
Tel. +39 0541 343030 - Fax +39 0541 345540  
istitutogiordano@giordano.it - [www.giordano.it](http://www.giordano.it)  
Cod. Fisc./P.Iva 00 549 540 409 - Cap. Soc. € 1.500.000 i.v.  
R.E.A. c/o C.C.I.A.A. (RN) 156766  
Registro Imprese di Rimini n.00 549 540 409

## TEST REPORT No. 297659

**Place and date of issue:** Bellaria-Igea Marina - Italy, 05/09/2012

**Customer:** ALUMIL ALUMINIUM INDUSTRY S.A. - Industrial Area - 61100 KILKIS - Greece

**Date test requested:** 29/05/2012

**Order number and date:** 56594, 05/06/2012

**Date specimen received:** 19/07/2012

**Test date:** 24/07/2012

**Purpose of test:** resistance to horizontal linear static loading in accordance with Ministry of Infrastructures Decree dated 14/01/2008 and resistance to dynamic loading in accordance with standards UNI 10807:1999, NF P01-013:1988 and UNI EN 14019:2004

**Test site:** Istituto Giordano S.p.A. - Via Erbosa, 72 - 47043 Gatteo (FC) - Italy

**Specimen origin:** sampled and supplied by the Customer

**Identification of specimen received:** No. 2012/1579

### Specimen name\*.

The test specimen is called "M8200 10+10 Top Mount".

(\* according to that stated by the Customer.

Comp. AV  
Revis


This test report consist of 9 sheets.

Sheet  
1 of 9

**Description of specimen\*.**

The test specimen is a railing described in following drawings.

**ELEVATION AND CROSS SECTION**

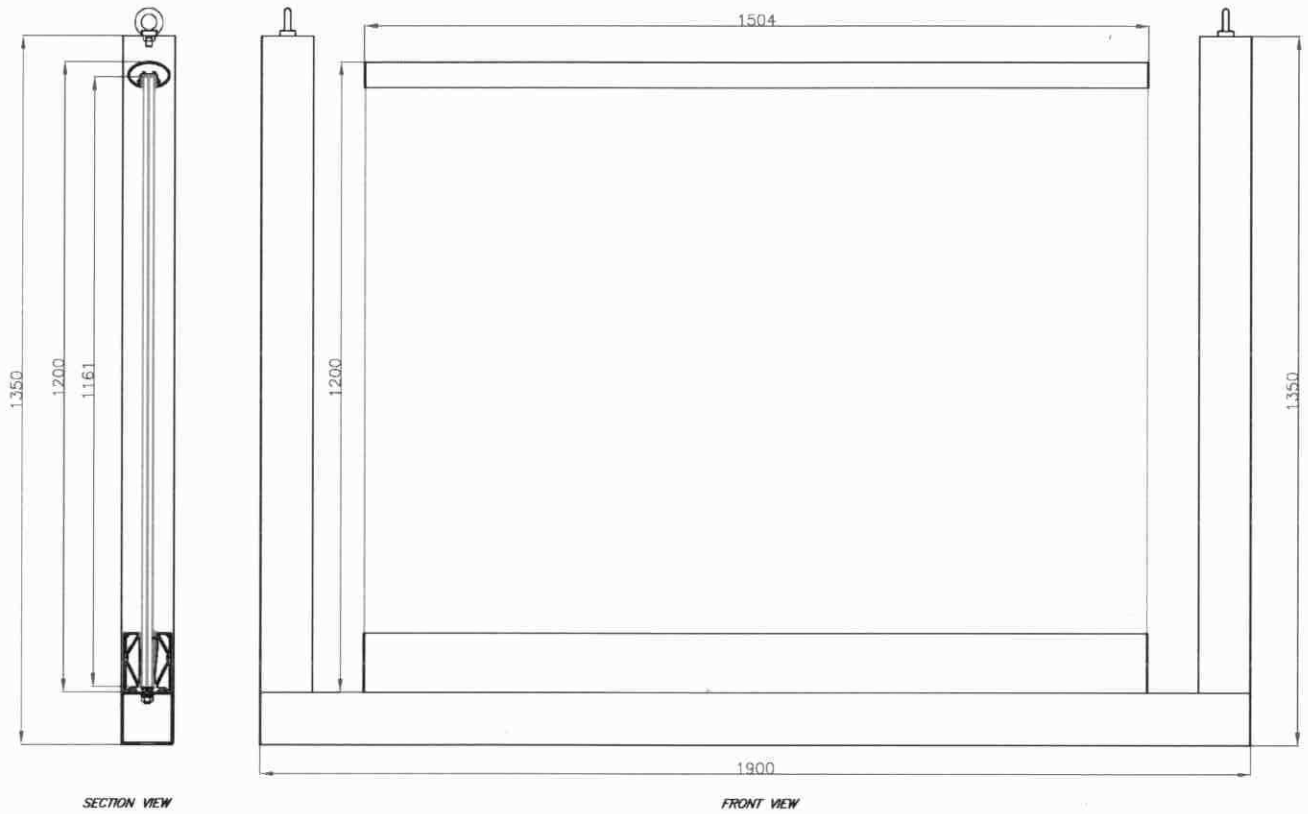

(\* ) according to that stated by the Customer.



### Findings.


On the basis of the test performed, the results obtained and the provisions of Ministry of Infrastructures Decree dated 14/01/2008 and standards UNI 10807:1999, NF 08-301:1991 and UNI EN 14019:2004, the test specimen, a railing called "M8200 10+10 Top Mount" submitted by the company ALUMIL ALUMINIUM INDUSTRY S.A. - Industrial Area - 61100 KILKIS - Greece, obtains the results given in the following table.

Test	Normative reference	Requirement	Result
horizontal linear static load	Ministry of Infrastructures Decree dated 14/01/2008 (table 3.1.II)	2,0 kN/m	compliant
dynamic load	UNI 10807:1999	300 mm	compliant
	NF 08-301:1991	1200 mm	compliant
	UNI EN 14019:2004	950 mm	compliant (class I5)


The results given refer exclusively to the test specimen itself and are only valid under the same conditions in which testing was carried out.

This test report alone shall not be considered a certificate of conformity.

Test Technician  
(Dott. Ing. Paolo Bertini)




Head of  
Security and Safety Laboratory  
(Geom. Roberto Porta)



Managing Director

L'AMMINISTRATORE DELEGATO  
Dott. Ing. Vincenzo Iommi

